


100 OR 200 AMP OVERHEAD SERVICE ON A STRUCTURE

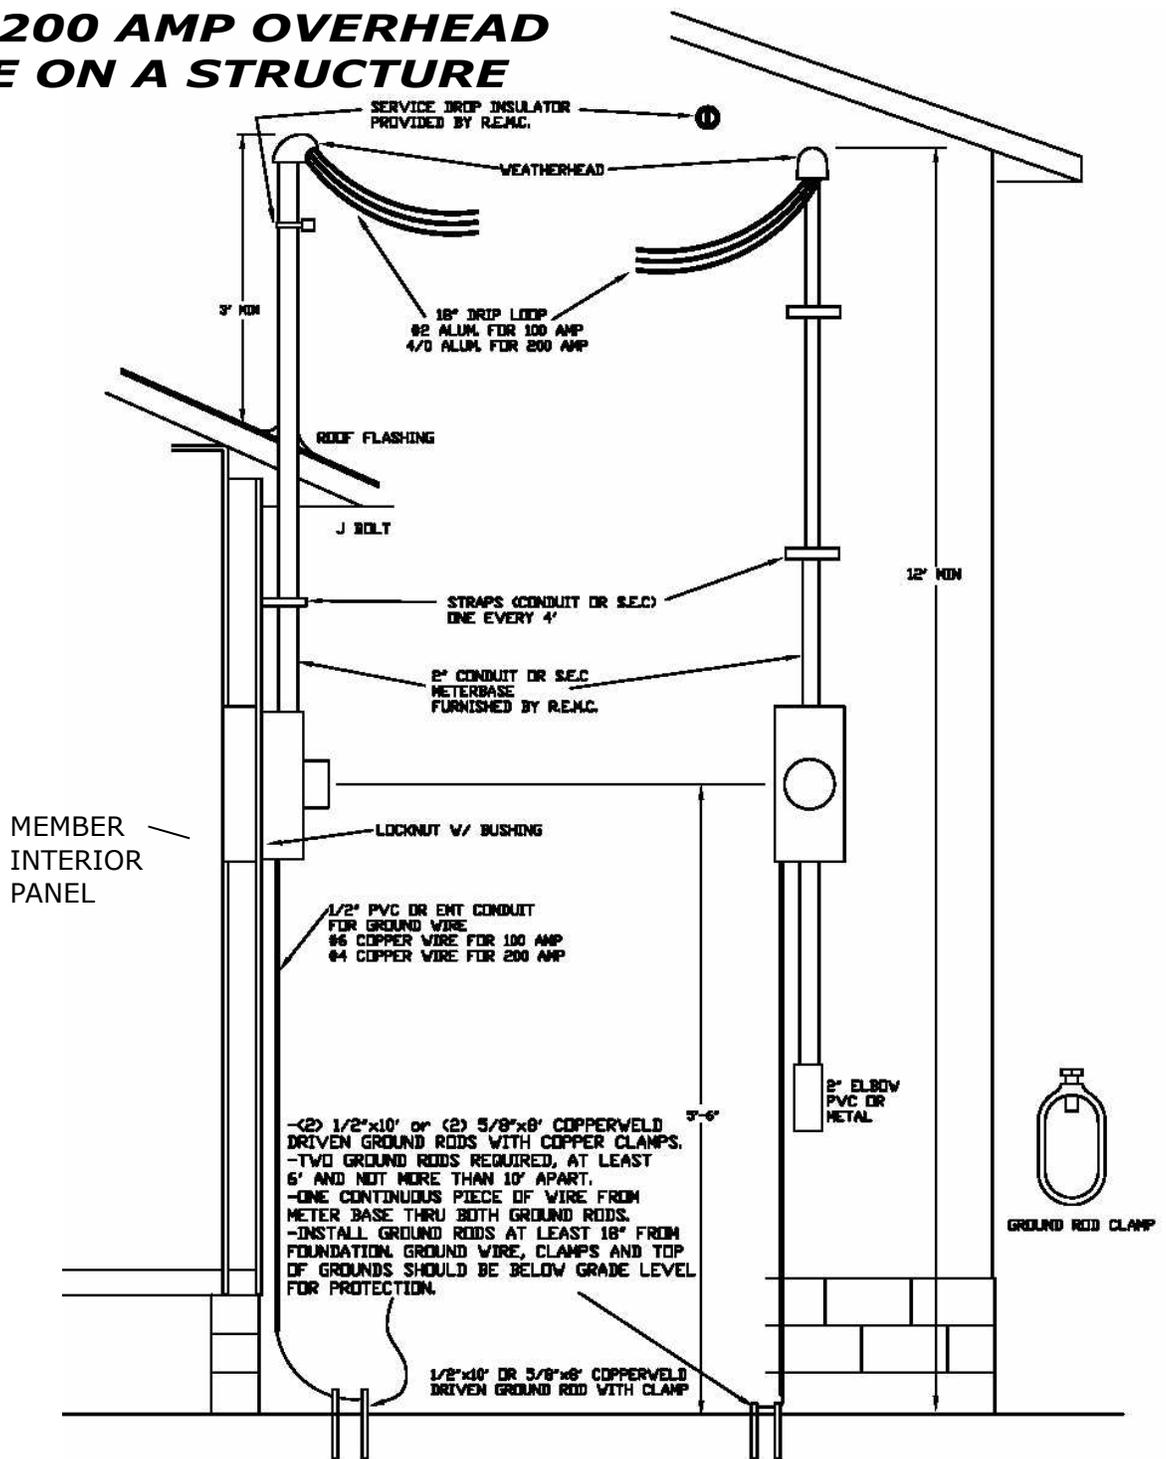

NOTES:

SERVICE ENTRANCE MUST BE BUILT BY THE MEMBER OR CONTRACTOR

- MARSHALL REMC METER SOCKET **MUST** BE GROUNDED
- OUTDOOR DISCONNECTS, AND CONDUIT RISER FURNISHED BY THE MEMBER
- 4 WIRE CONDUCTOR IS RECOMMENDED PAST THE DISCONNECT. CHECK LOCAL BUILDING CODES FOR REQUIREMENTS.
- A DISCONNECT IS REQUIRED IF METER SOCKET IS MORE THAN 6' FROM THE INTERIOR PANEL

- ALL SERVICE ENTRANCES MUST BE INSPECTED AND PASSED BY THE COUNTY BUILDING INSPECTOR PRIOR TO REMC CONNECTION